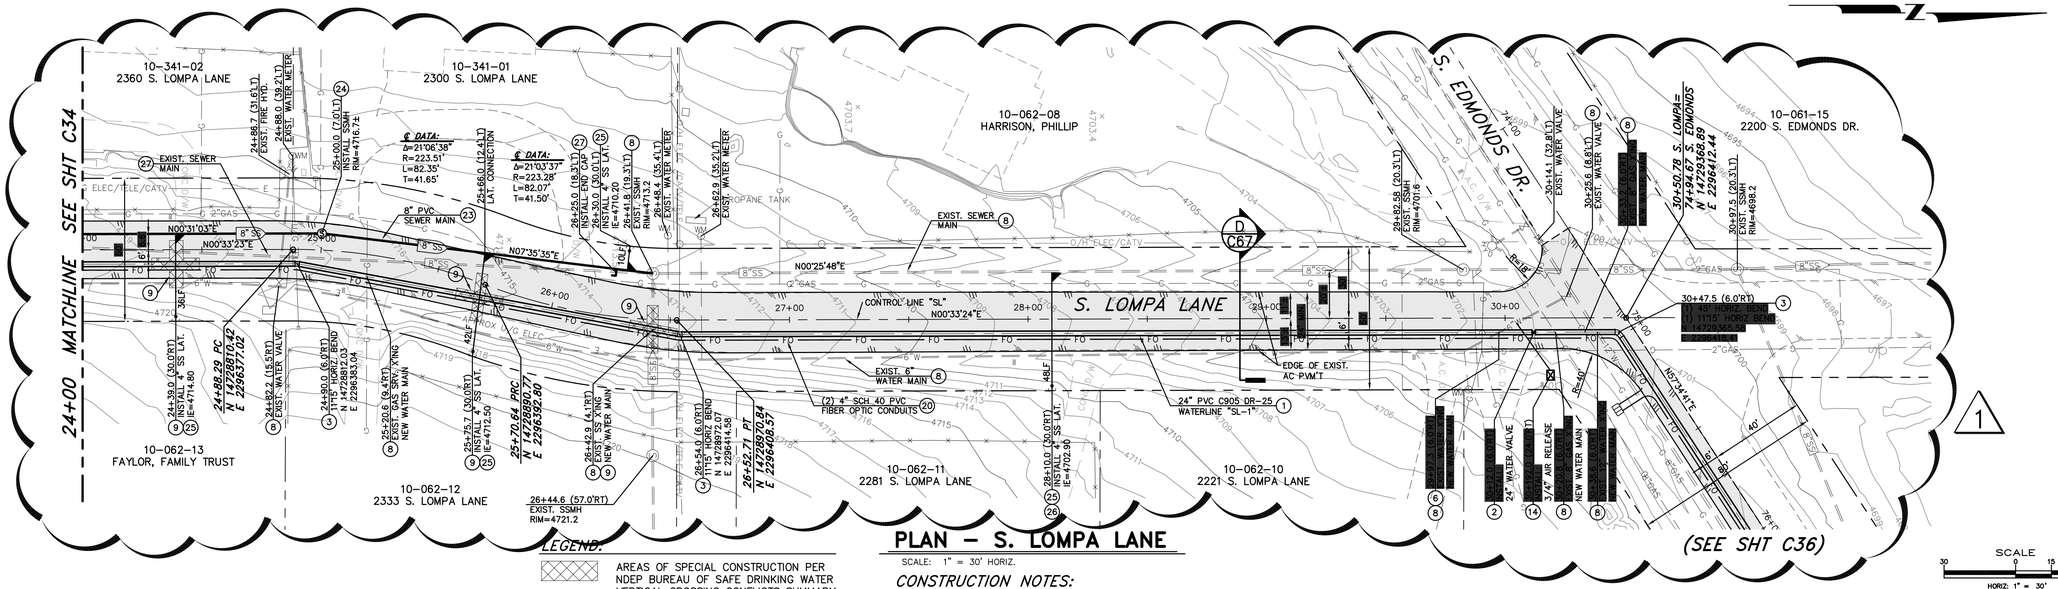

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

PLAN – S. LOMPA LANE

SCALE: 1" = 30' HORIZ.

SEWER NOTE:

THE CONTRACTOR SHALL USE DUE CARE IN INSTALLING SEWER MAINS, MANHOLES AND LATERALS, ALL MANHOLES AND LATERAL LOCATIONS INCLUDING INVERT ELEVATIONS SHALL BE LAID OUT IN THE FIELD BY A NEVADA LICENSED PROFESSIONAL LAND SURVEYOR. TWO OFFSET STAKES SHALL BE PROVIDED FOR EACH MANHOLE AND LATERAL LOCATION. PRIOR TO PLACEMENT OF MANHOLE SECTIONS OR BURYING OF LATERAL END PLUGS, THE LOCATION AND ELEVATION OF EACH MANHOLE BASE AND LATERAL SHALL BE VERIFIED BY THE CARSON CITY INSPECTOR AND THE CONTRACTOR. SEWER MANHOLES AND LATERALS INSTALLED AT LOCATIONS OR ELEVATIONS OTHER THAN AS SHOWN ON THE PLANS WILL REQUIRE REMOVAL AND REPLACEMENT AT THE CONTRACTORS EXPENSE. FOLLOWING INSTALLATION, SEWER MAINS WILL BE TELEVISED BY CARSON CITY PERSONNEL; ANY AREAS OF PONDING WATER WILL REQUIRE REMOVAL AND REPLACEMENT AT THE CONTRACTORS EXPENSE.

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
2. INSTALL 24" BUTTERFLY VALVE PER DETAIL 1, SHEET C61, WITH NUT EXTENDER TO EXTEND TOP OF NUT TO BETWEEN 18" TO 24" FROM TOP OF VALVE BOX.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
6. WATER MAIN CROSSING EXISTING UTILITY PER STD DRAWINGS C-3.1.8 & C3.1.9
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
14. INSTALL 3/4" POTABLE WATER AIR RELEASE PER STD. DRAWING C-3.1.10
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
23. INSTALL 8" PVC SDR35 SEWER LINE PER STD. DRAWING C-1.2.1
24. INSTALL SEWER MANHOLE TYPE 1 PER STD. DRAWING C-2.1.3, ADJUST RIM TO ADJACENT FINISH GRADE.
25. INSTALL 4" PVC SDR35 SEWER LATERAL PER STD. DRAWING C-2.2.1, SUBSTITUTE 4" PVC C-900 WHEN SEWER LATERAL IS LOCATED ABOVE WATER MAINS.
26. INSTALL 4" PVC SEWER SERVICE TAP SADDLE PER STD. DRAWING C-2.2.2
27. CUT, CAP AND SLURRY FILL EXISTING SEWER MAIN TO BE ABANDONED IN PLACE.

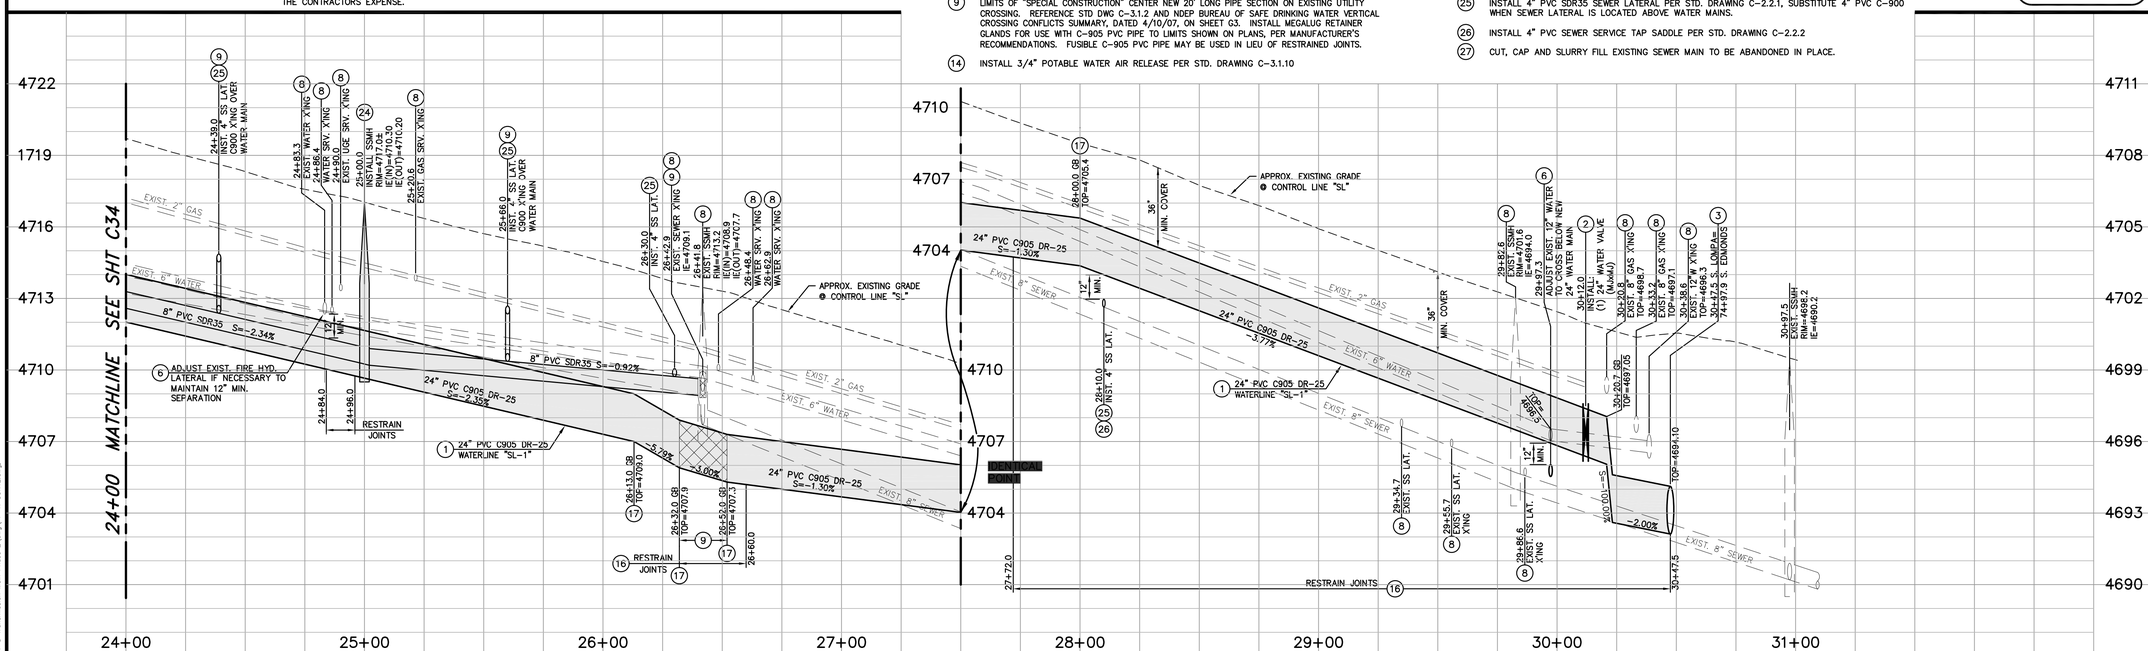

PROFILE – S. LOMPA LANE

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: pp-n conte.dwg
SCALE (HORIZ): 1"=30'
SCALE (VERT): 1"=3'
PLOT DATE: 3/15/11

CARSON CITY PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	ADDED/REVISED PAVING LIMITS	DR	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN PROJECT – PHASE 2
PROJECT No. 4.0800
SOUTH LOMPA LANE
PLAN & PROFILE
STA 24+00 to STA 31+00

SHEET C35 OF 96

N:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-N CONTE.dwg

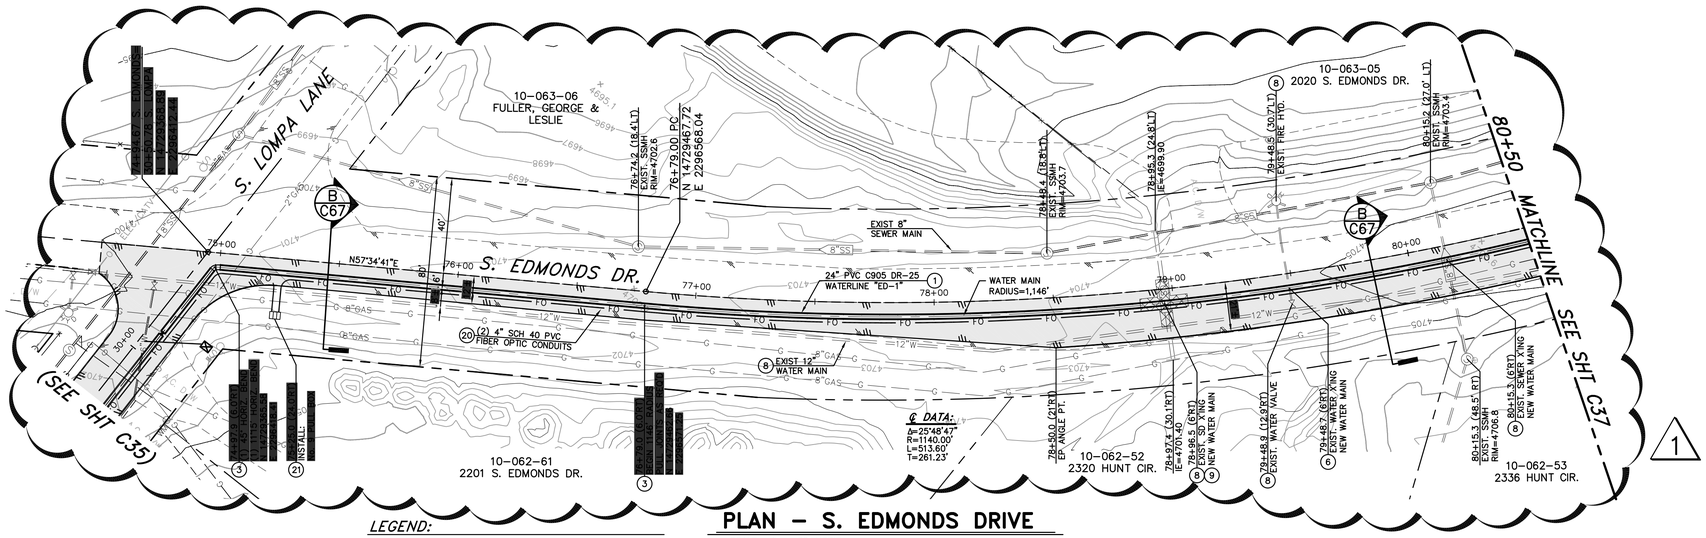

PLAN – S. EDMONDS DRIVE

SCALE: 1" = 30' HORIZ.

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURER'S RECOMMENDATIONS.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
6. WATER MAIN CROSSING EXISTING UTILITY PER STD DRAWINGS C-3.1.8 & C3.1.9
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.

SCALE
30 0 15 30
HORIZ: 1" = 30'

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811
OR
1-800-227-2600

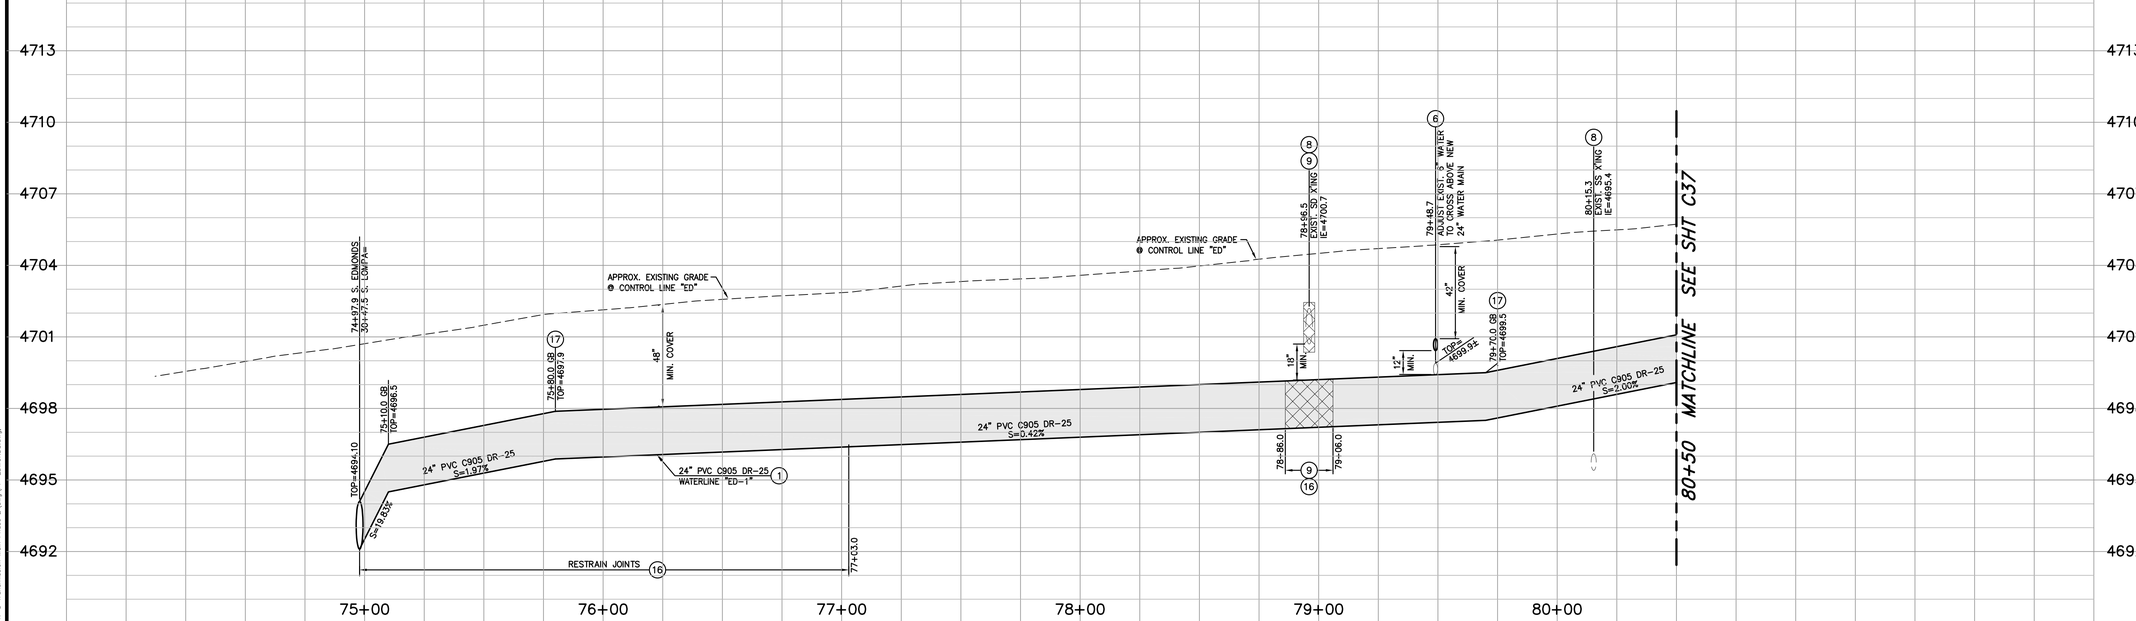

PROFILE – S. EDMONDS DRIVE

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY:	DGR
DRAWN BY:	DGR/DLO
CHECKED BY:	TLG
DWG NO.:	pp-edmonds.dwg
SCALE (HORIZ):	1"=30'
SCALE (VERT):	1"=1'
PLOT DATE:	3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON QUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	ADDED/REVISED PAVING LIMITS	DR	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
SOUTH EDMONDS DRIVE
PLAN & PROFILE
STA 75+00 to STA 80+50

SHEET C36 OF 96

M:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-EDMONDS.dwg

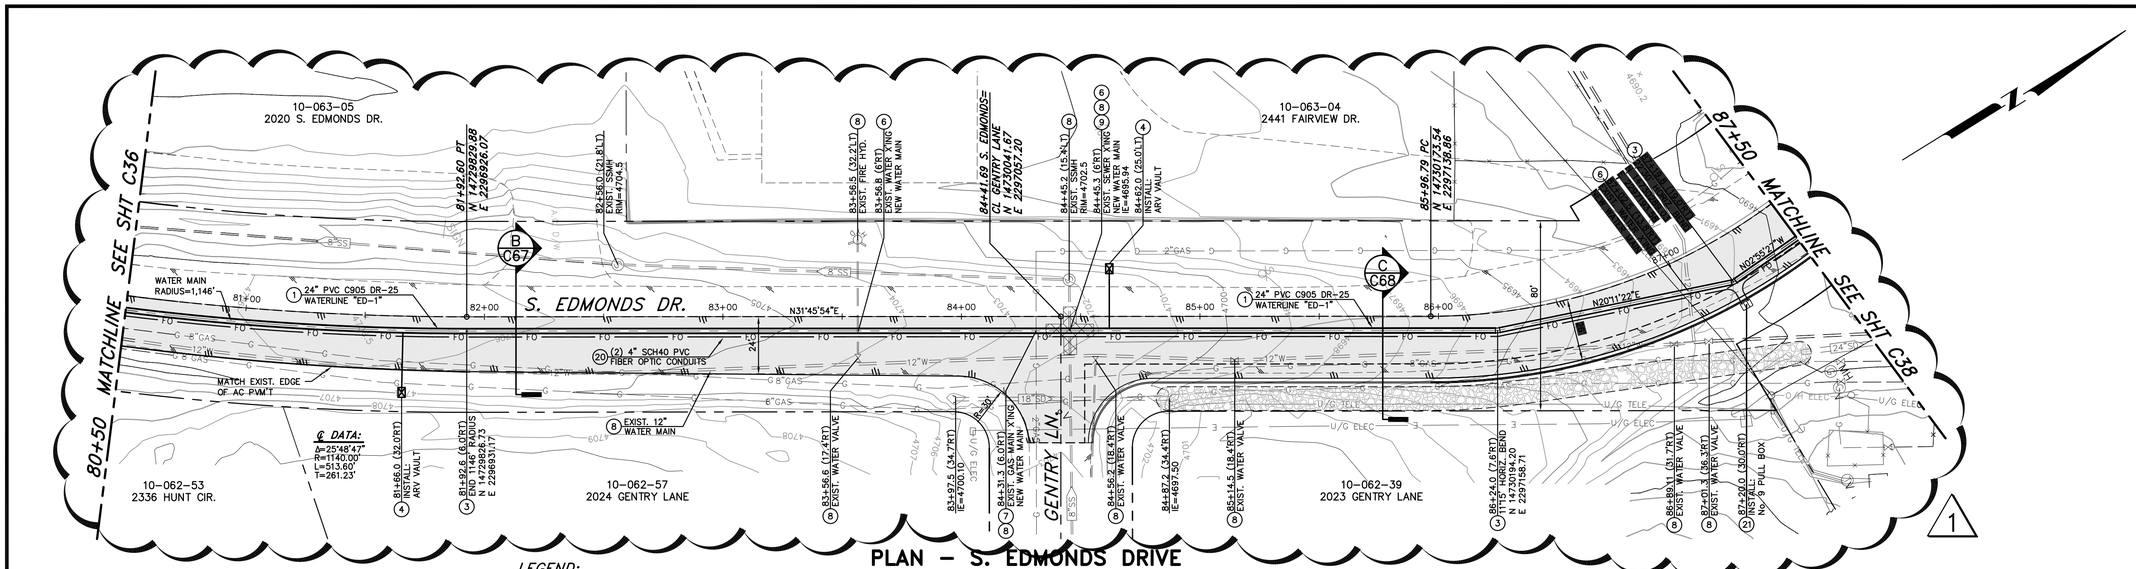

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

PLAN – S. EDMONDS DRIVE

SCALE: 1" = 30' HORIZ.

REFERENCE SHEETS C55 TO C58 FOR S. EDMONDS AND FAIRVIEW DR. ROADWAY IMPROVEMENTS

SCALE 30 0 15 30
HORIZ: 1" = 30'

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
6. WATER MAIN CROSSING EXISTING UTILITY PER STD DRAWINGS C-3.1.8 & C3.1.9
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.

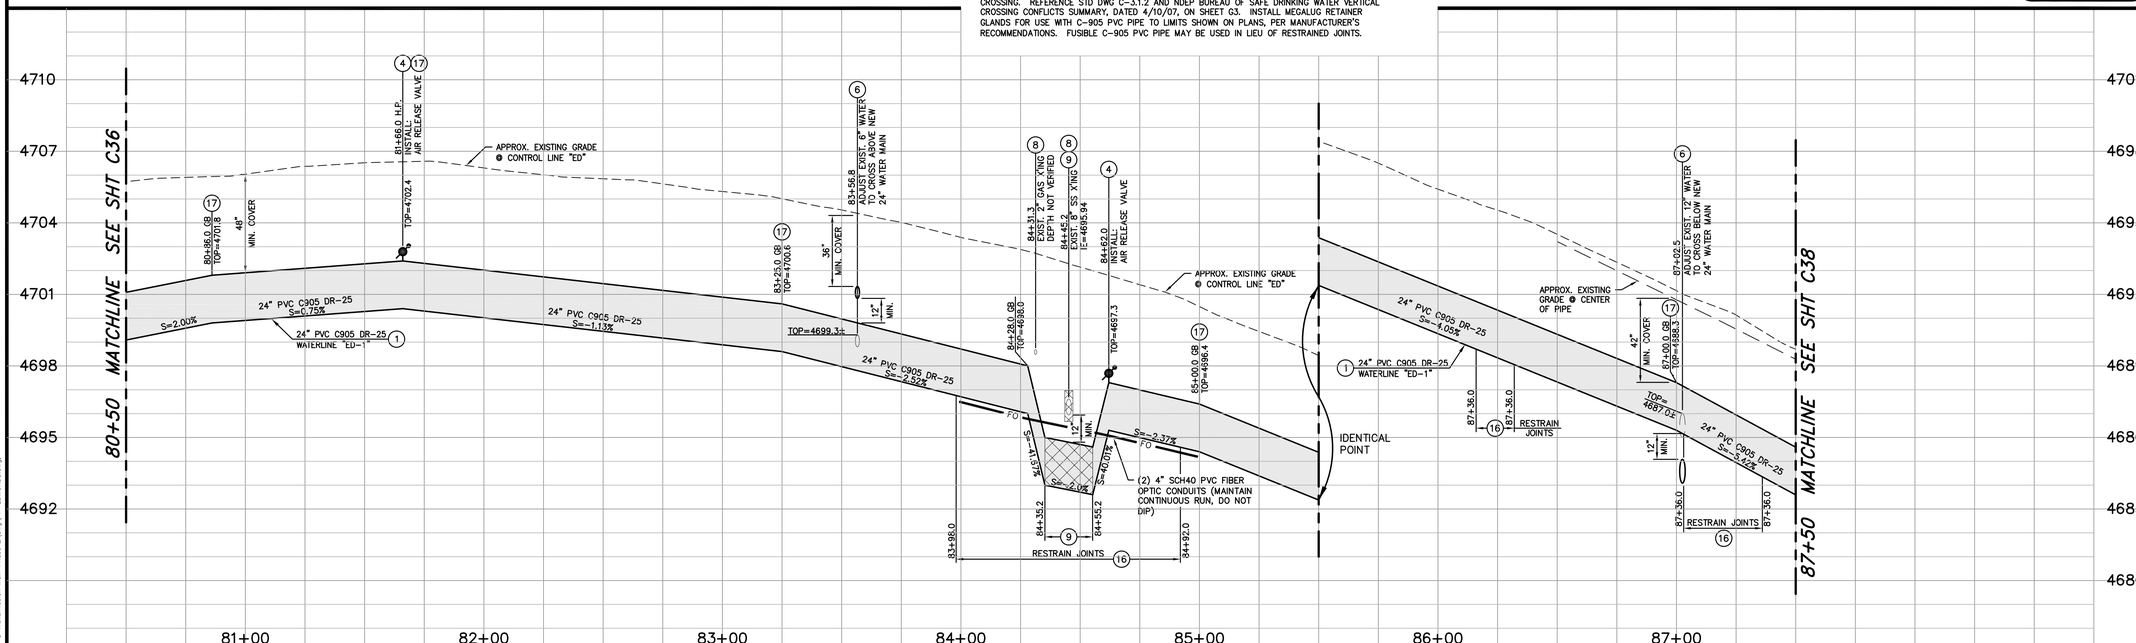

PROFILE – S. EDMONDS DRIVE

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: pp-edmonds.dwg
SCALE (HORIZ): 1"=30'
SCALE (VERT): 1"=1'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON QUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	ADDED/REVISED PAVING LIMITS	DR	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
SOUTH EDMONDS DRIVE
PLAN & PROFILE
STA 80+50 to STA 87+50

SHEET C37 OF 96

I:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-EDMONDS.dwg

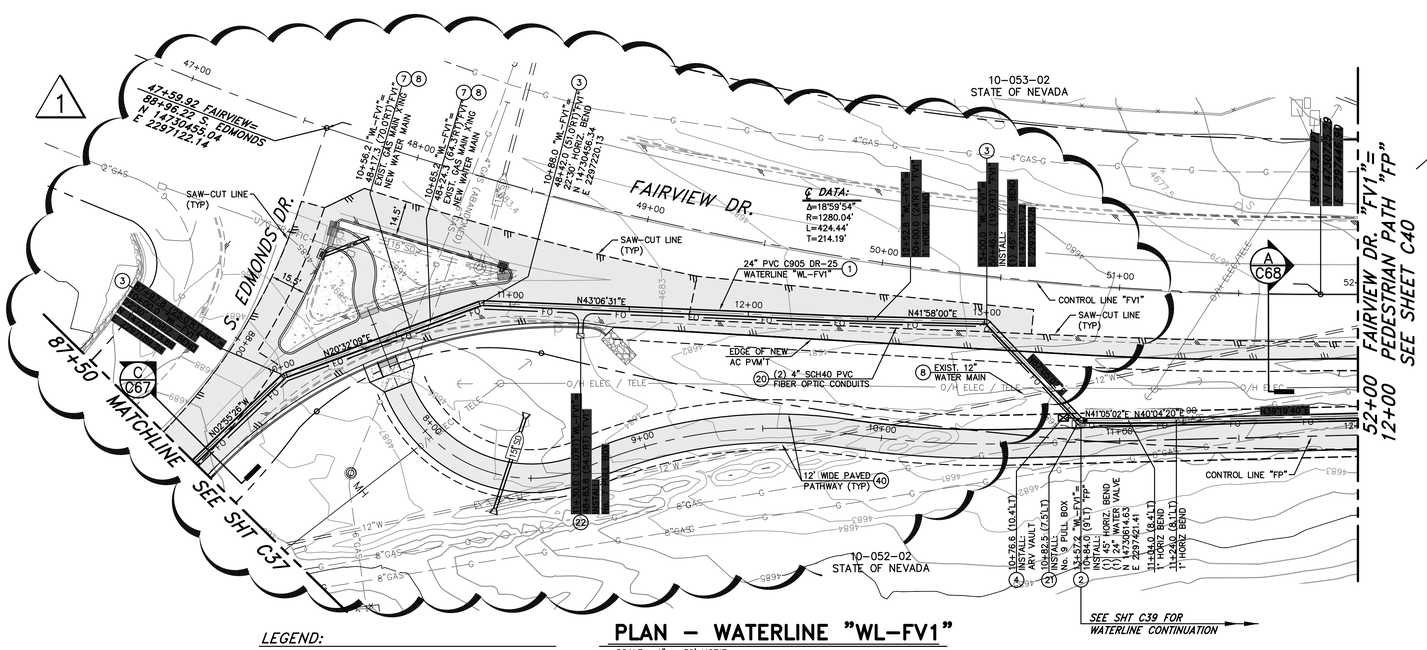

PLAN – WATERLINE "WL-FV1"

SCALE: 1" = 30' HORIZ.

REFERENCE SHEET C39 FOR PEDESTRIAN PATH DESIGN.

REFERENCE SHEETS C55 TO C58 FOR S. EDMONDS AND FAIRVIEW DR. ROADWAY IMPROVEMENTS

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
2. INSTALL 24" BUTTERFLY VALVE PER DETAIL 1, SHEET C61, WITH NUT EXTENDER TO EXTEND TOP OF NUT TO BETWEEN 18" TO 24" FROM TOP OF VALVE BOX.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
7. POTHOLE TO VERIFY EXACT DEPTH AND/OR MAKE & MATERIALS REQUIRED.
8. PROTECT-IN-PLACE
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
22. INSTALL No. 7 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.

SCALE
30 0 15 30
HORIZ: 1" = 30'

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811
OR
1-800-227-2600

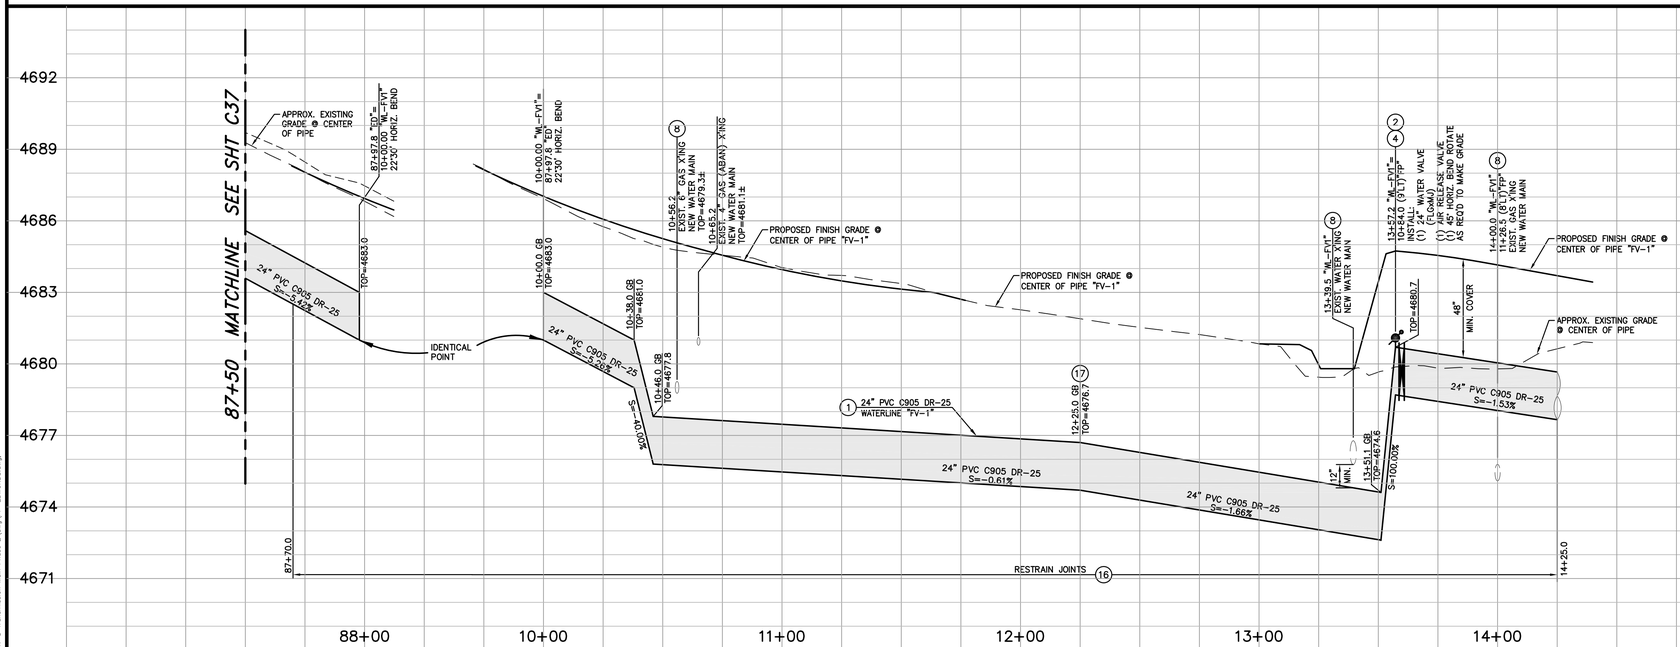

PROFILE – WATERLINE "WL-FV1"

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: pp-edmonds.dwg
SCALE (HORIZ): 1"=30'
SCALE (VERT): 1"=1'
PLOT DATE: 3/15/11

CARSON CITY PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	ADDED/REVISED PAVING LIMITS	DR	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN PROJECT – PHASE 2
PROJECT No. 4.0800
SOUTH EDMONDS DRIVE
PLAN & PROFILE
STA 24+00 to STA 31+00

SHEET C38 OF 96

I:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-EDMONDS.dwg

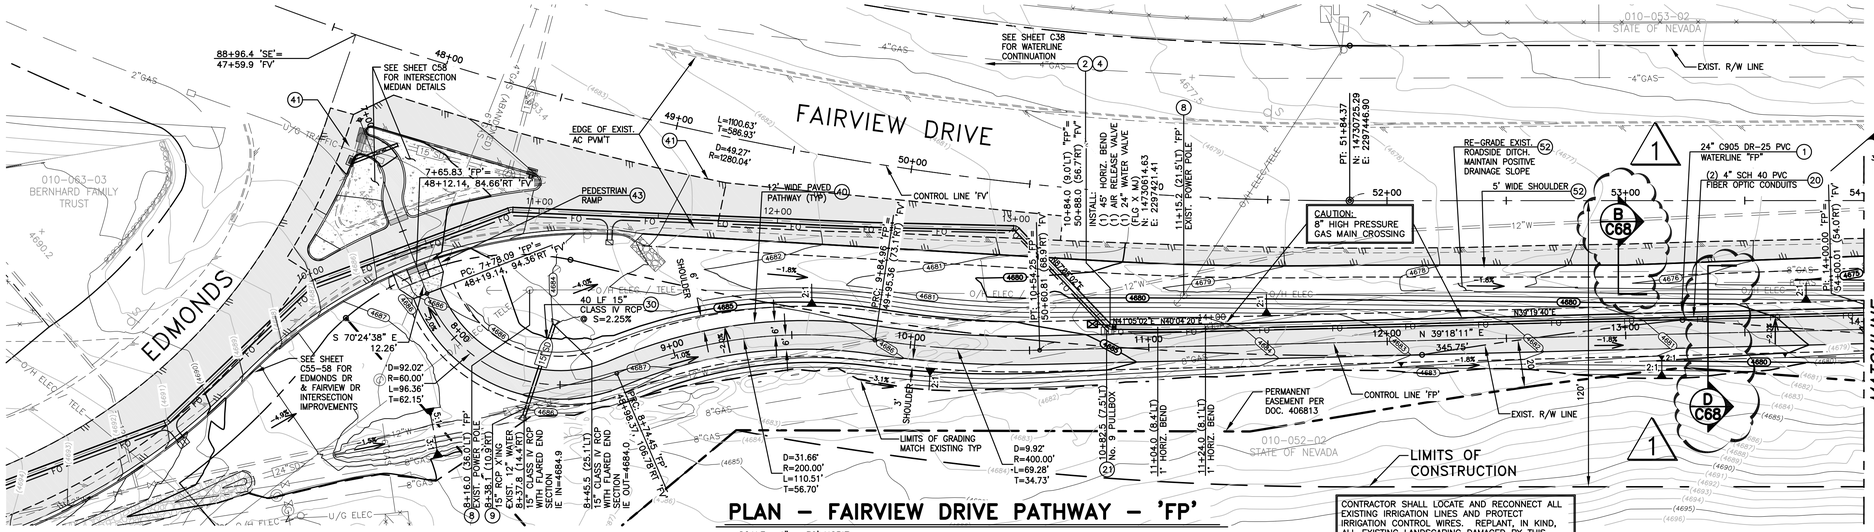

CONTRACTOR SHALL LOCATE AND RECONNECT ALL EXISTING IRRIGATION LINES AND PROTECT IRRIGATION CONTROL WIRES. REPLANT, IN KIND, ALL EXISTING LANDSCAPING DAMAGED BY THIS CONTRUCTION.

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

NOTES:

1. REFERENCE SHEETS C55 TO C58 FOR S. EDMONDS AND FAIRVIEW DRIVE ROADWAY IMPROVEMENTS
2. REFERENCE SHEET C47 FOR STORM DRAIN PLAN AND PROFILE.

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
2. INSTALL 24" BUTTERFLY VALVE PER DETAIL 1, SHEET C61, WITH NUT EXTENDER TO EXTEND TOP OF NUT TO BETWEEN 18" TO 24" FROM TOP OF VALVE BOX.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
30. INSTALL STORM DRAIN PIPE PER STD DRAWING C-1.2.1, (SIZE AND CLASS PER PLAN)
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.
41. SAWCUT, REMOVE AND REPLACE EXISTING ASPHALT PER STD DRAWING C-5.1.6.
43. CONSTRUCT PERPENDICULAR CURB RAMP DIRECTIONAL PER STD. DRAWING C-5.3.2.
52. RE-GRADE EXISTING ROADWAY SHOULDER PER TYPICAL SECTION A, SHEET C68. PROVIDE FILL MATERIAL WHERE REQUIRED.

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 or 1-800-227-2600

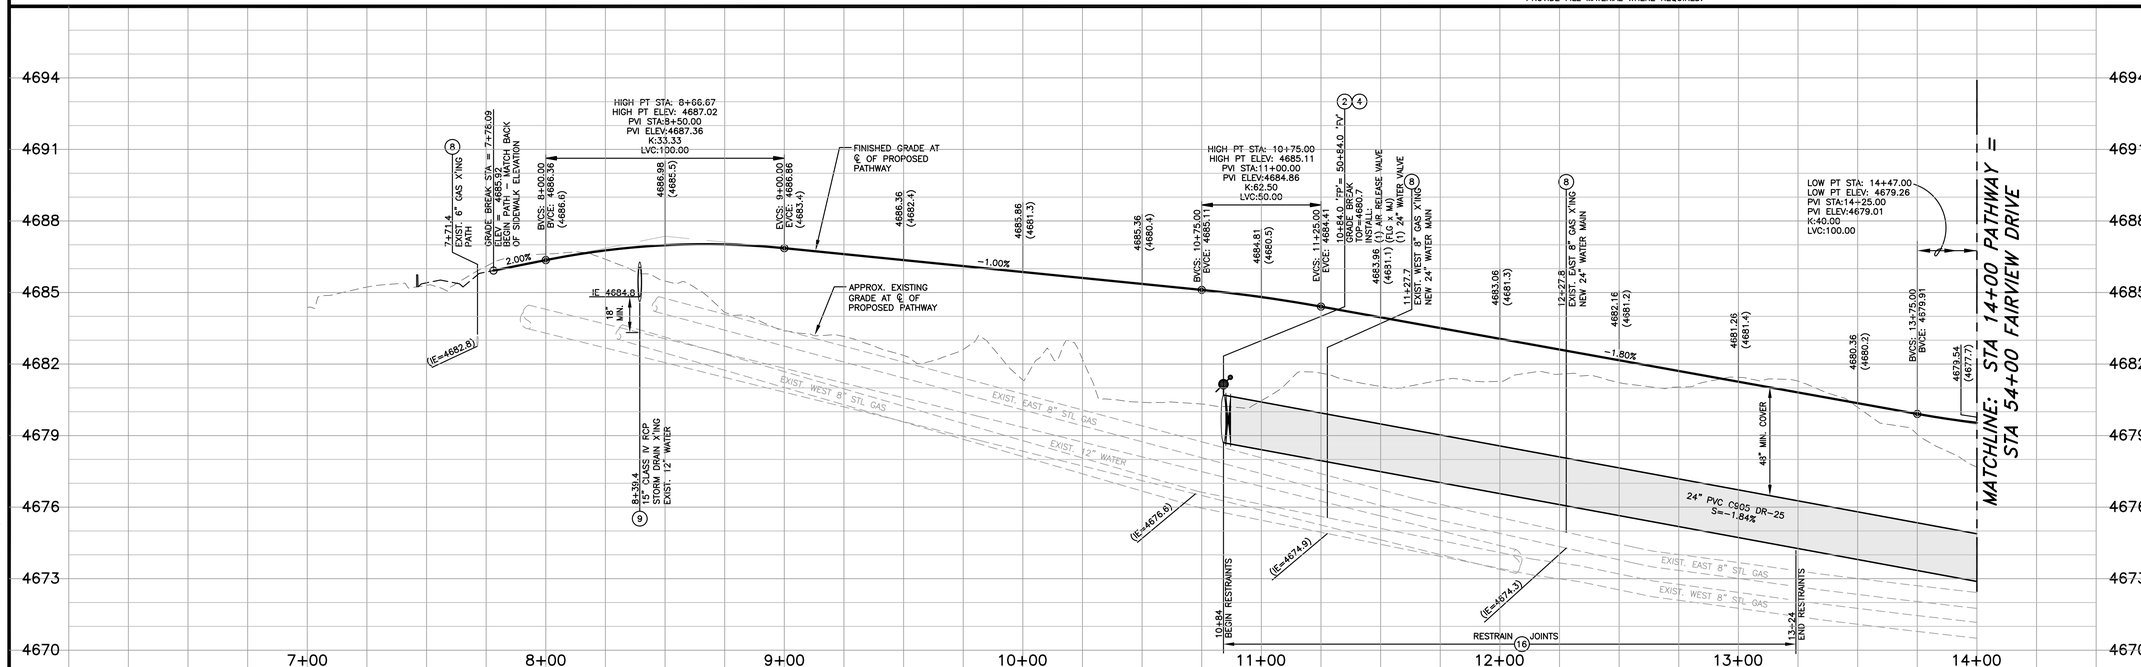

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: gis-fairview p7-54.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 7+00 to STA 14+00

SHEET C39 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

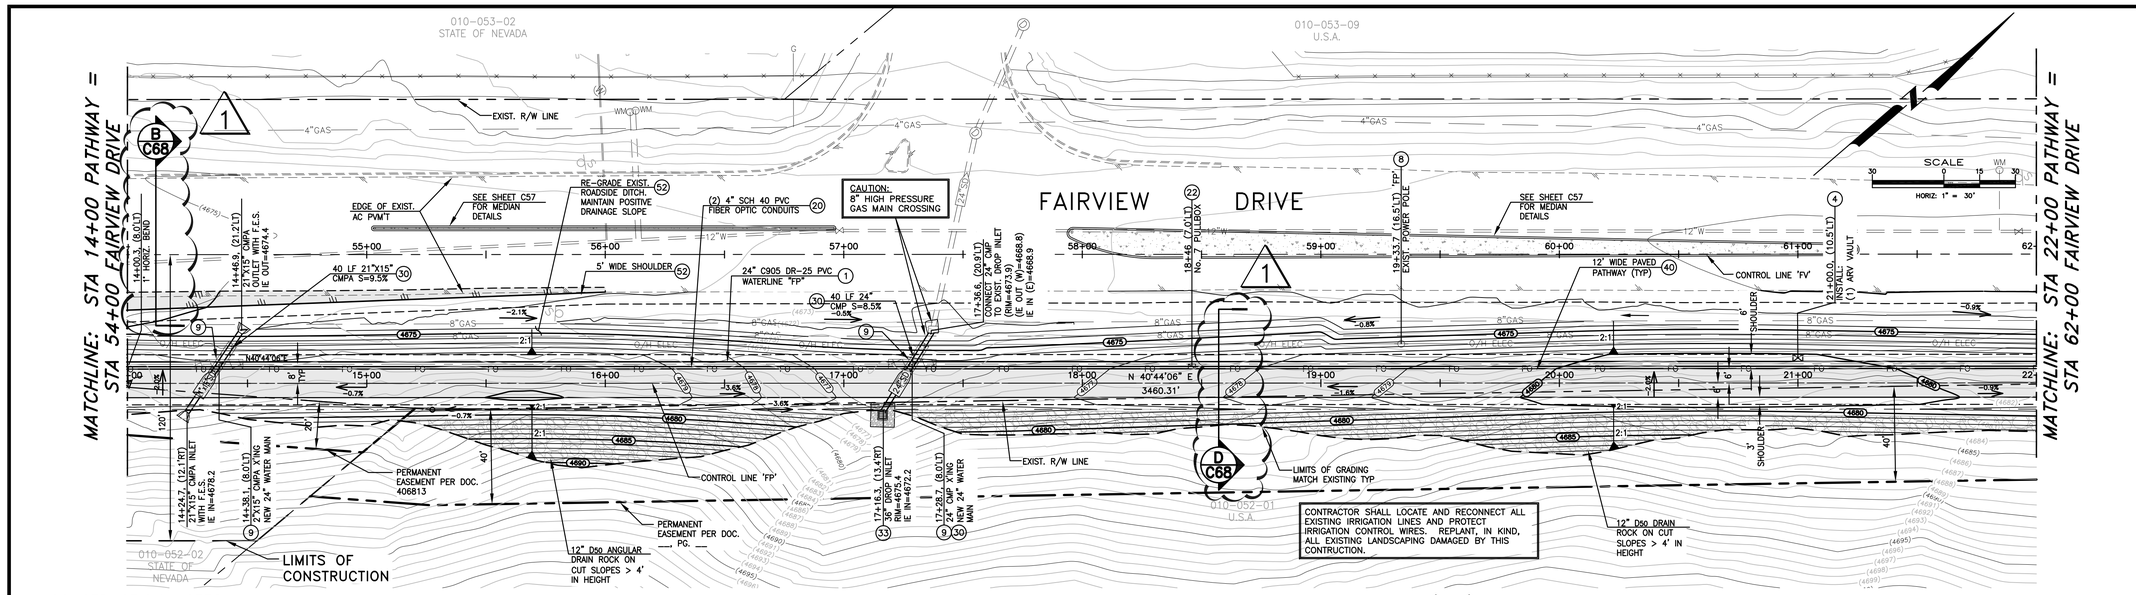

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
22. INSTALL No. 7 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
30. INSTALL STORM DRAIN PIPE PER STD DRAWING C-1.2.1, (SIZE AND CLASS PER PLAN)
33. INSTALL CATCH BASIN TYPE 4-R PER STD. DWG C-4.1.5
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.
52. RE-GRADE EXISTING ROADWAY SHOULDER PER TYPICAL SECTION A, SHEET C68. PROVIDE FILL MATERIAL WHERE REQUIRED.

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

NOTES:

1. REFERENCE SHEETS C55 TO C58 FOR S. EDMONDS AND FAIRVIEW DRIVE ROADWAY IMPROVEMENTS
2. REFERENCE SHEET C48 FOR STORM DRAIN PLAN AND PROFILE.

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

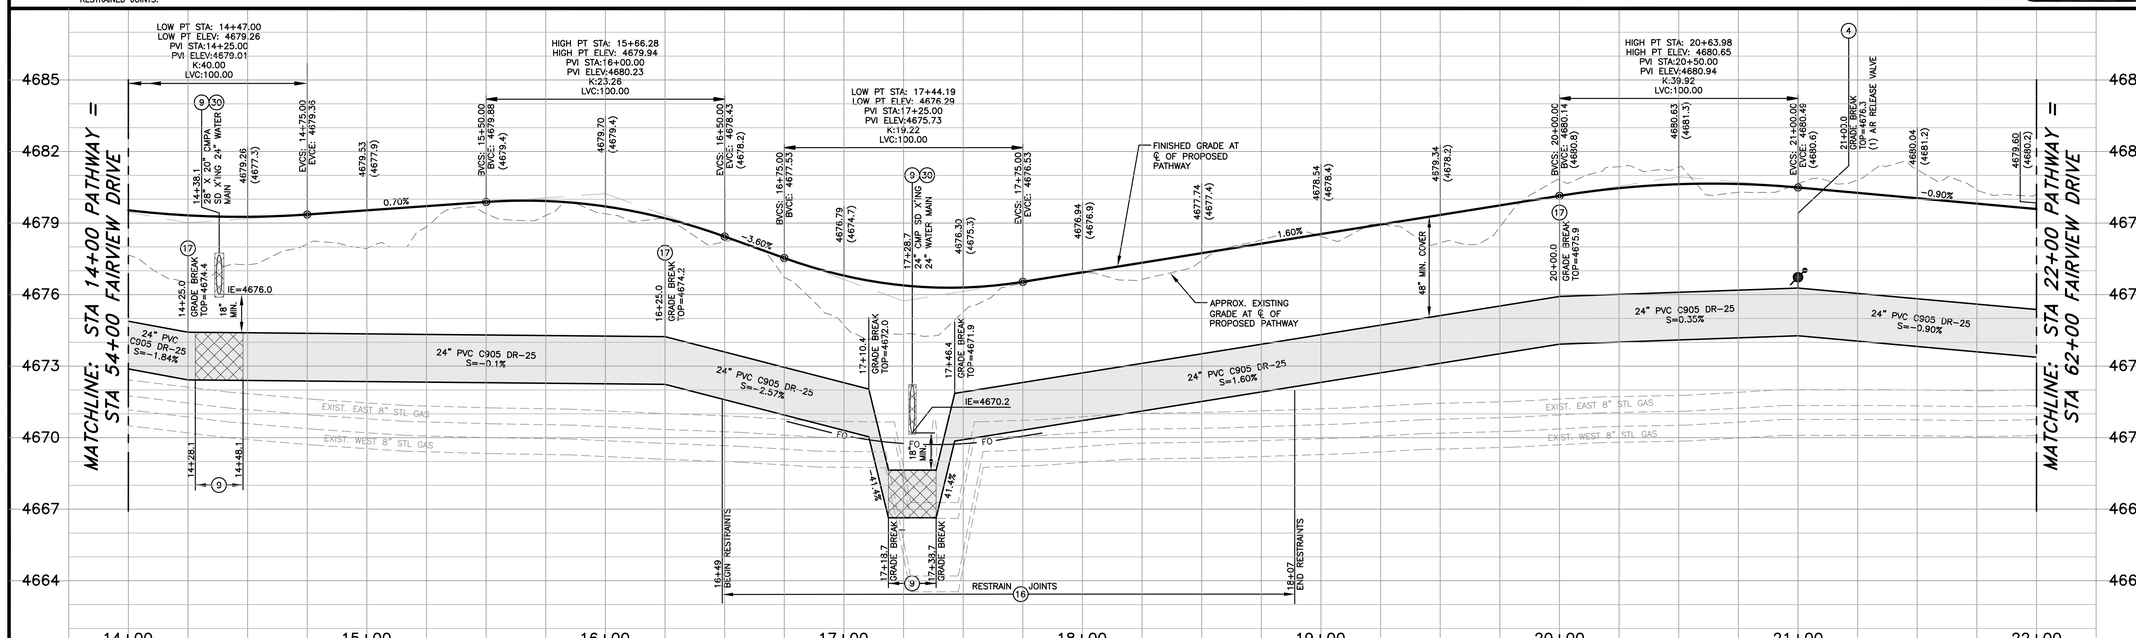

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: gp-fairview p7-54.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800

FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 14+00 to STA 22+00

SHEET C40 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

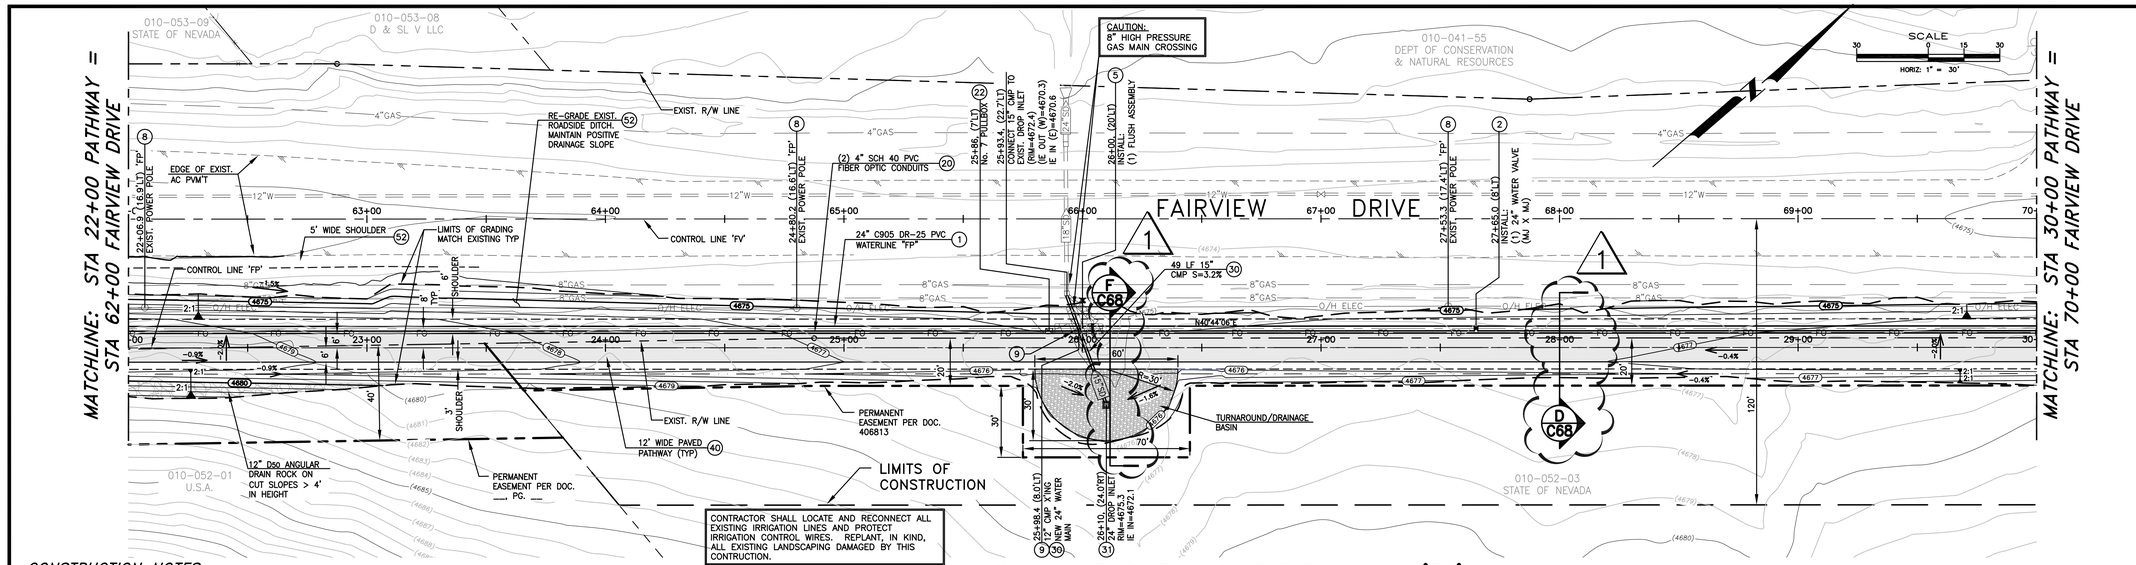

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
2. INSTALL 24" BUTTERFLY VALVE PER DETAIL 1, SHEET C61, WITH NUT EXTENDER TO EXTEND TOP OF NUT TO BETWEEN 18" TO 24" FROM TOP OF VALVE BOX.
5. INSTALL FLUSH ASSEMBLY PER DETAIL 3, SHEET C63.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
22. INSTALL No. 7 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
30. INSTALL STORM DRAIN PIPE PER STD DRAWING C-1.2.1, (SIZE AND CLASS PER PLAN)
31. INSTALL 24"x24" PRE-CAST CONCRETE DROP INLET WITH TRAFFIC RATED PEDESTRIAN FRAME & GRATE PER DETAIL 4, SHEET C65.
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.
52. RE-GRADE EXISTING ROADWAY SHOULDER PER TYPICAL SECTION A, SHEET C68. PROVIDE FILL MATERIAL WHERE REQUIRED.

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

NOTE:
1. REFERENCE SHEET C48 FOR STORM DRAIN PLAN AND PROFILE.

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

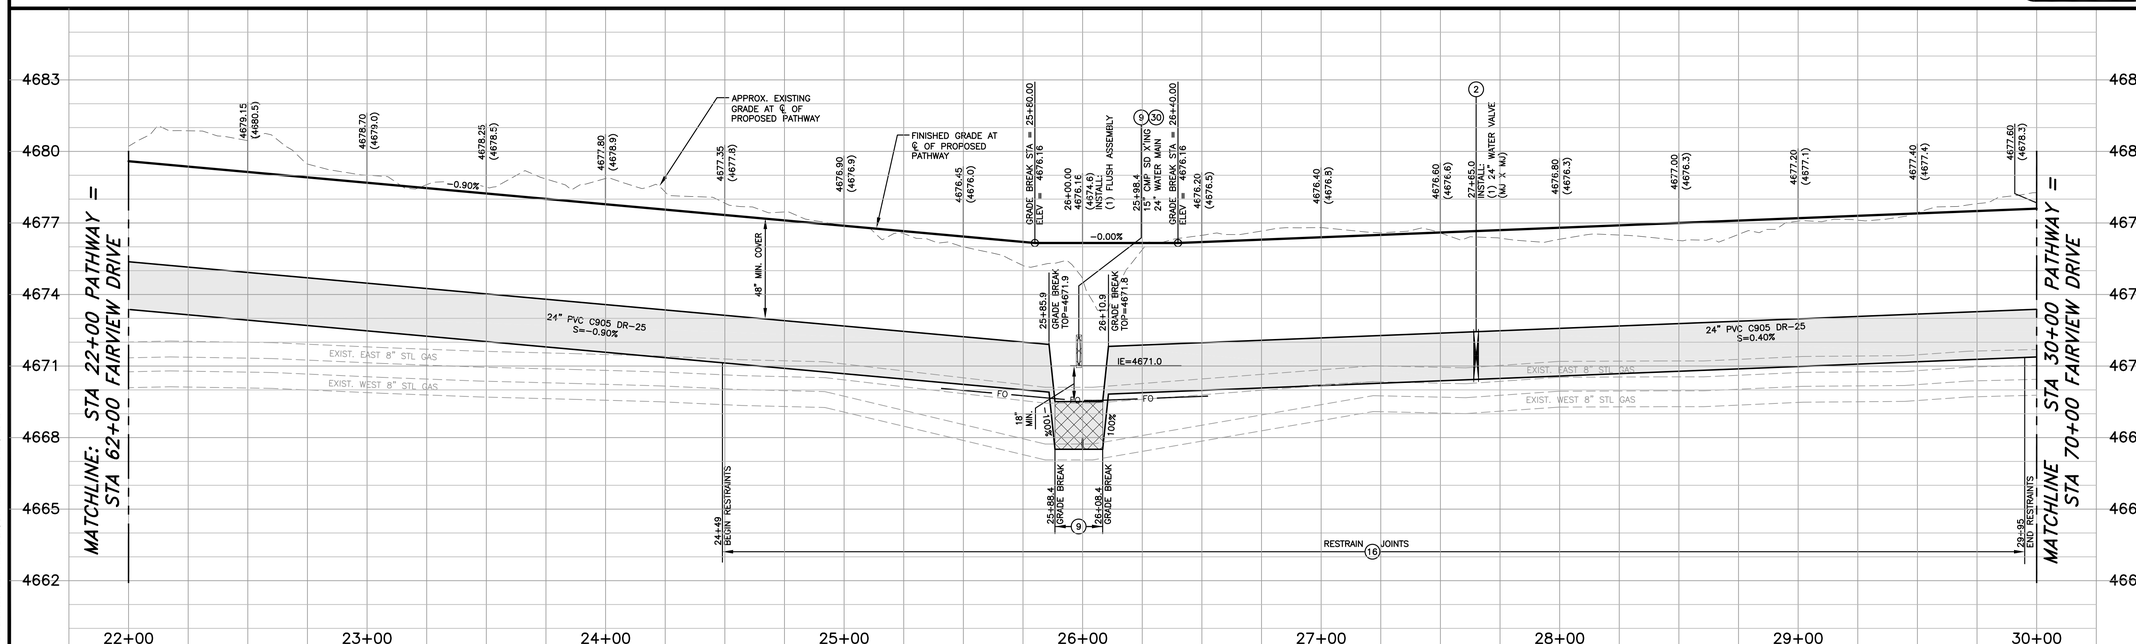

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY:	DGR/DLO
DRAWN BY:	DGR/DLO
CHECKED BY:	TLG
DWG NO.: gp-fairview p7-54.dwg	
SCALE (HORIZ):	1" = 30'
SCALE (VERT):	1" = 3'
PLOT DATE:	3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 22+00 to STA 30+00

SHEET C41 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

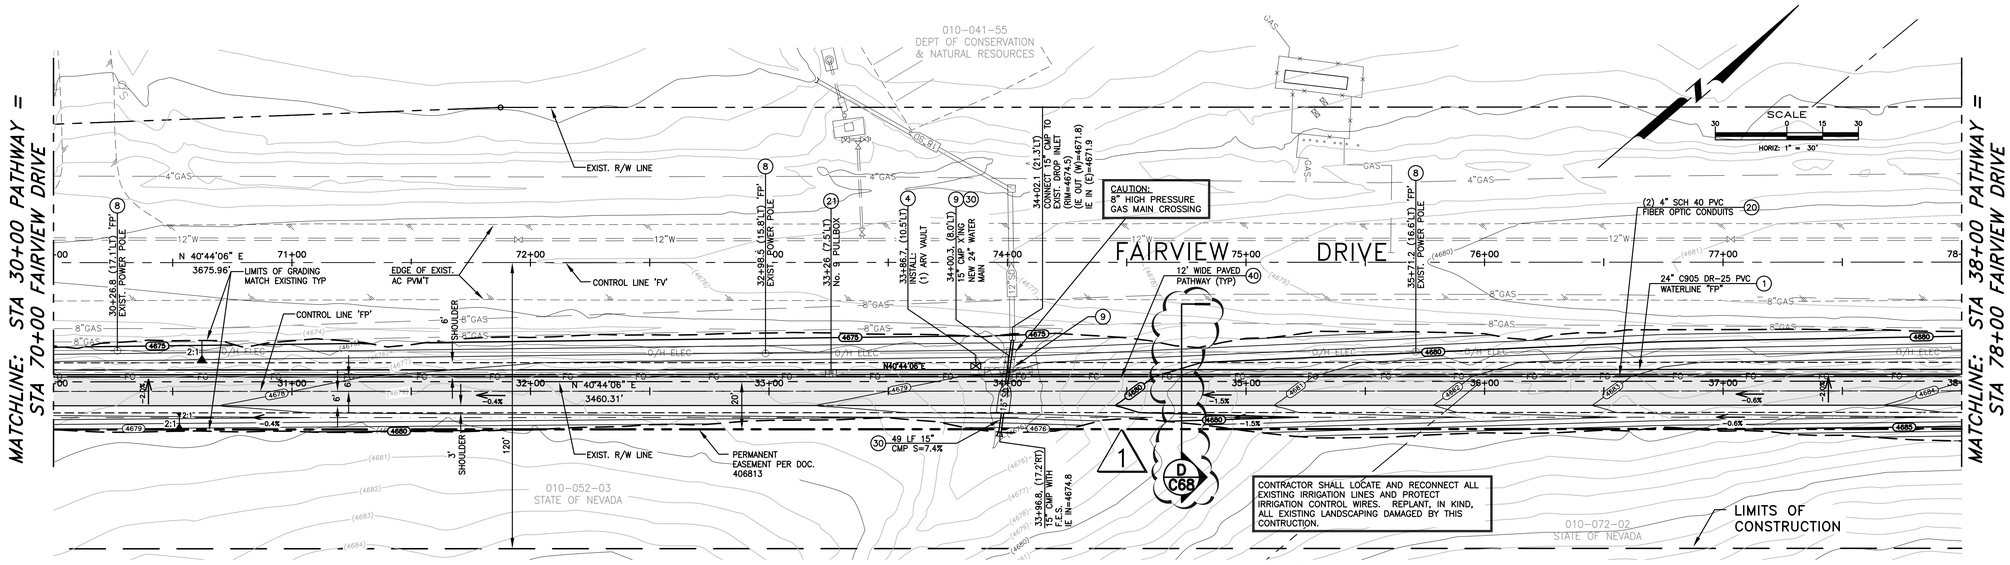

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
30. INSTALL STORM DRAIN PIPE PER STD DRAWING C-1.2.1, (SIZE AND CLASS PER PLAN)
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.

NOTE:

1. *REFERENCE SHEET C48 FOR STORM DRAIN PLAN AND PROFILE.*

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 or 1-800-227-2600

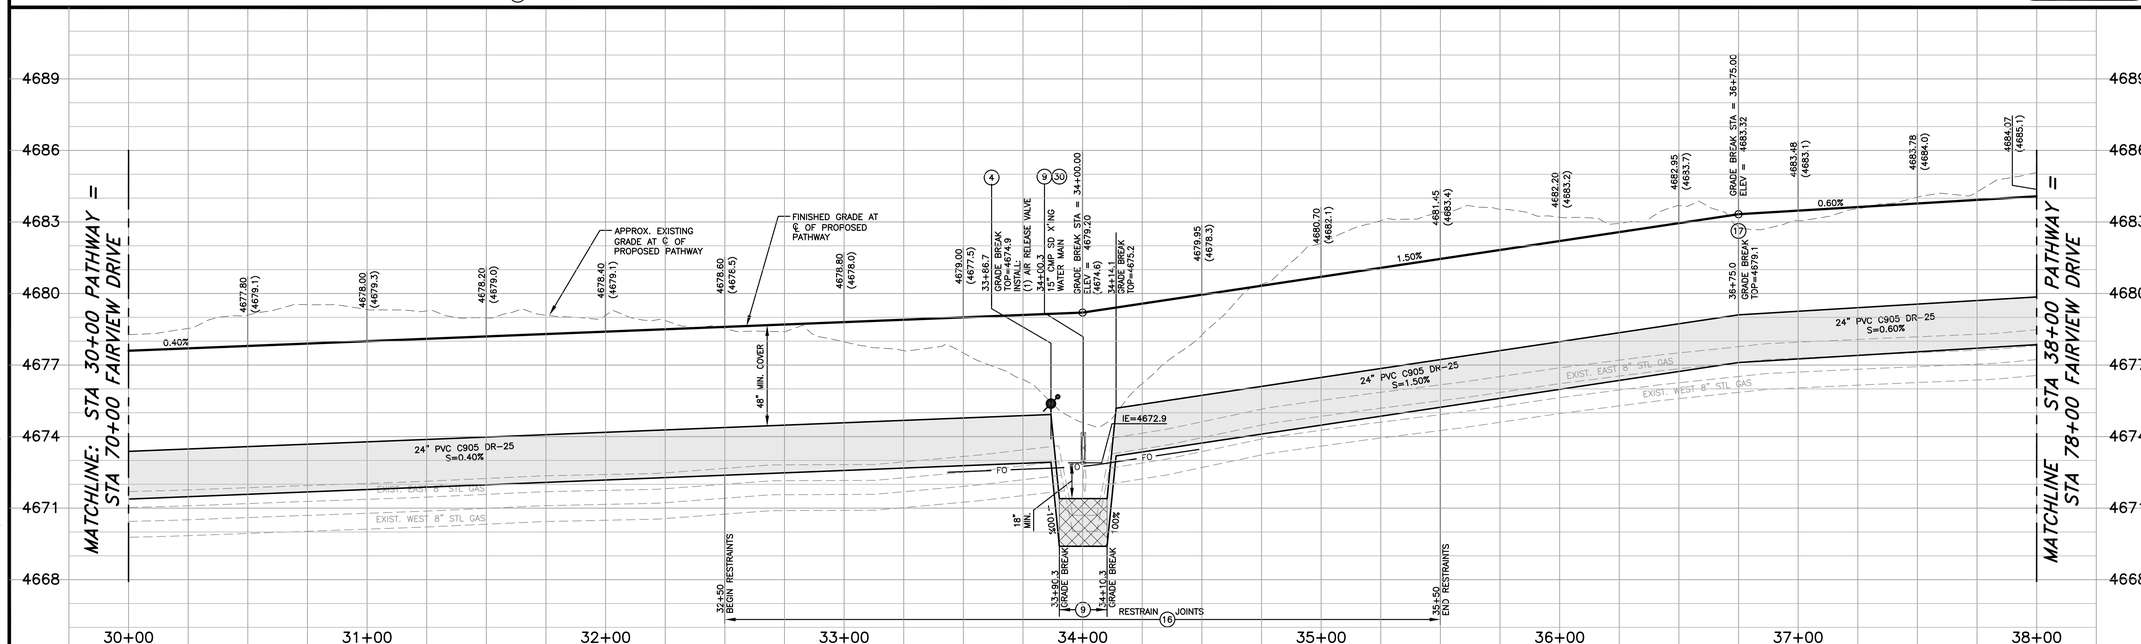

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: gp-fairview p7-54.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER - STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 30+00 to STA 38+00

SHEET C42 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

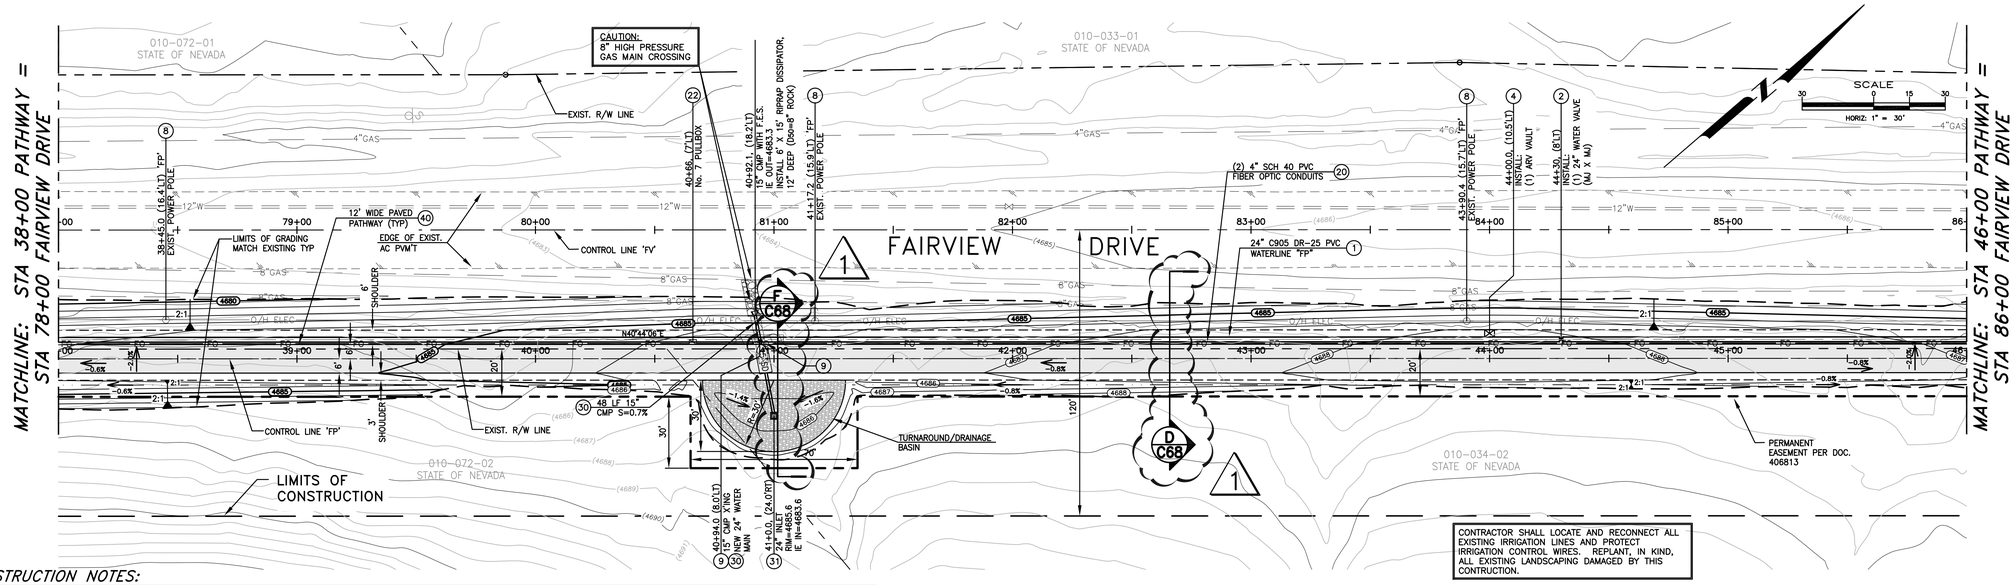

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
2. INSTALL 24" BUTTERFLY VALVE PER DETAIL 1, SHEET C61, WITH NUT EXTENDER TO EXTEND TOP OF NUT TO BETWEEN 18" TO 24" FROM TOP OF VALVE BOX.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
22. INSTALL No. 7 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
30. INSTALL STORM DRAIN PIPE PER STD DRAWING C-1.2.1, (SIZE AND CLASS PER PLAN)
31. INSTALL 24"x24" PRE-CAST CONCRETE DROP INLET WITH TRAFFIC RATED PEDESTRIAN FRAME & GRATE PER DETAIL 4, SHEET C65.
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

NOTE:
1. *REFERENCE SHEET C49 FOR STORM DRAIN PLAN AND PROFILE.*

LEGEND:

AREAS OF SPECIAL CONSTRUCTION PER NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

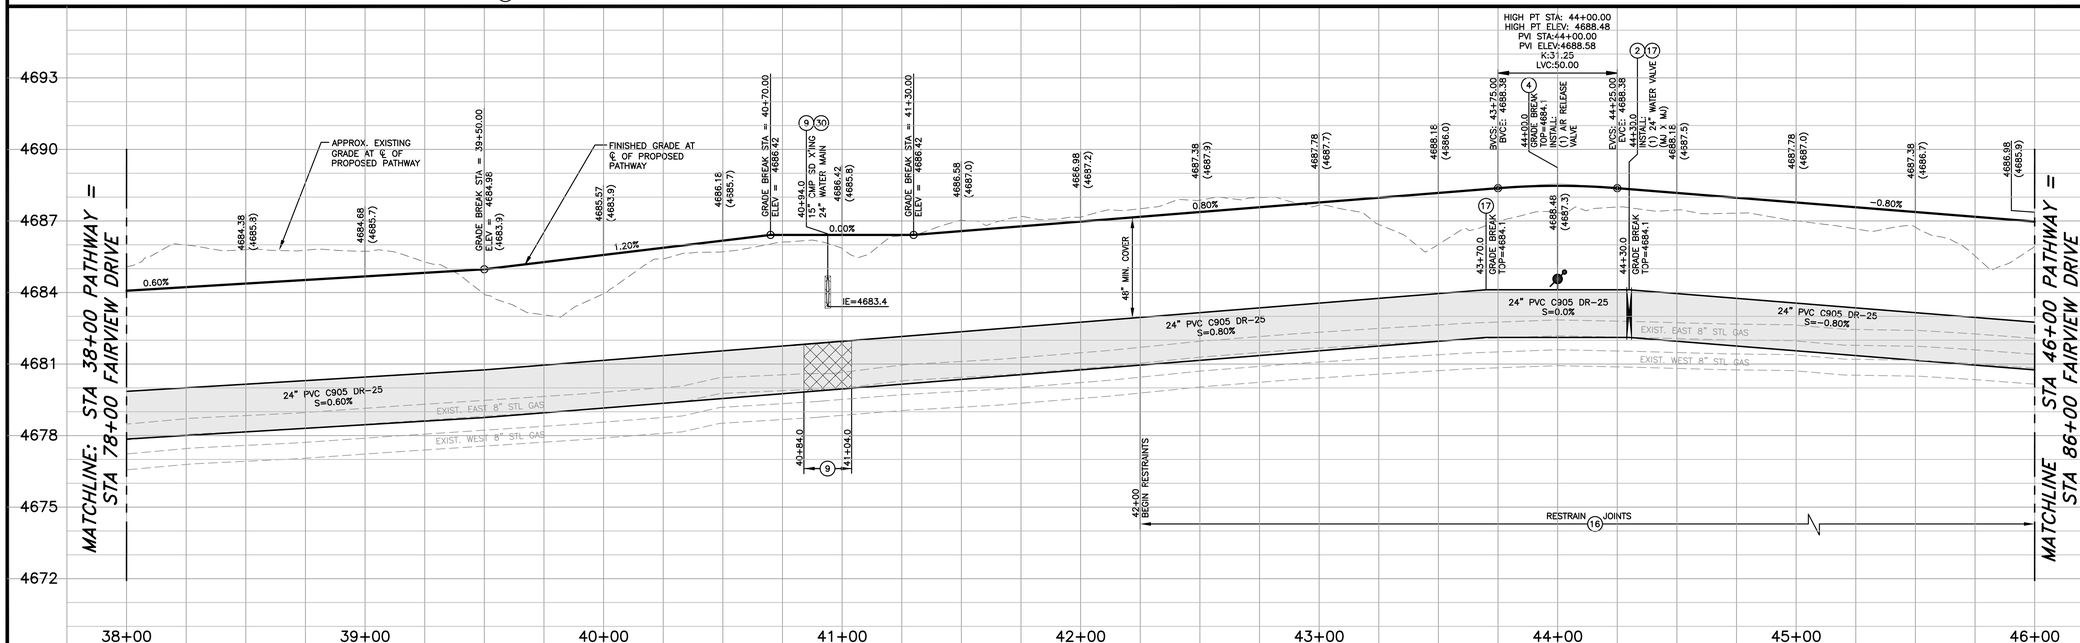

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: gp-fairview p7-54.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 38+00 to STA 46+00

SHEET C43 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

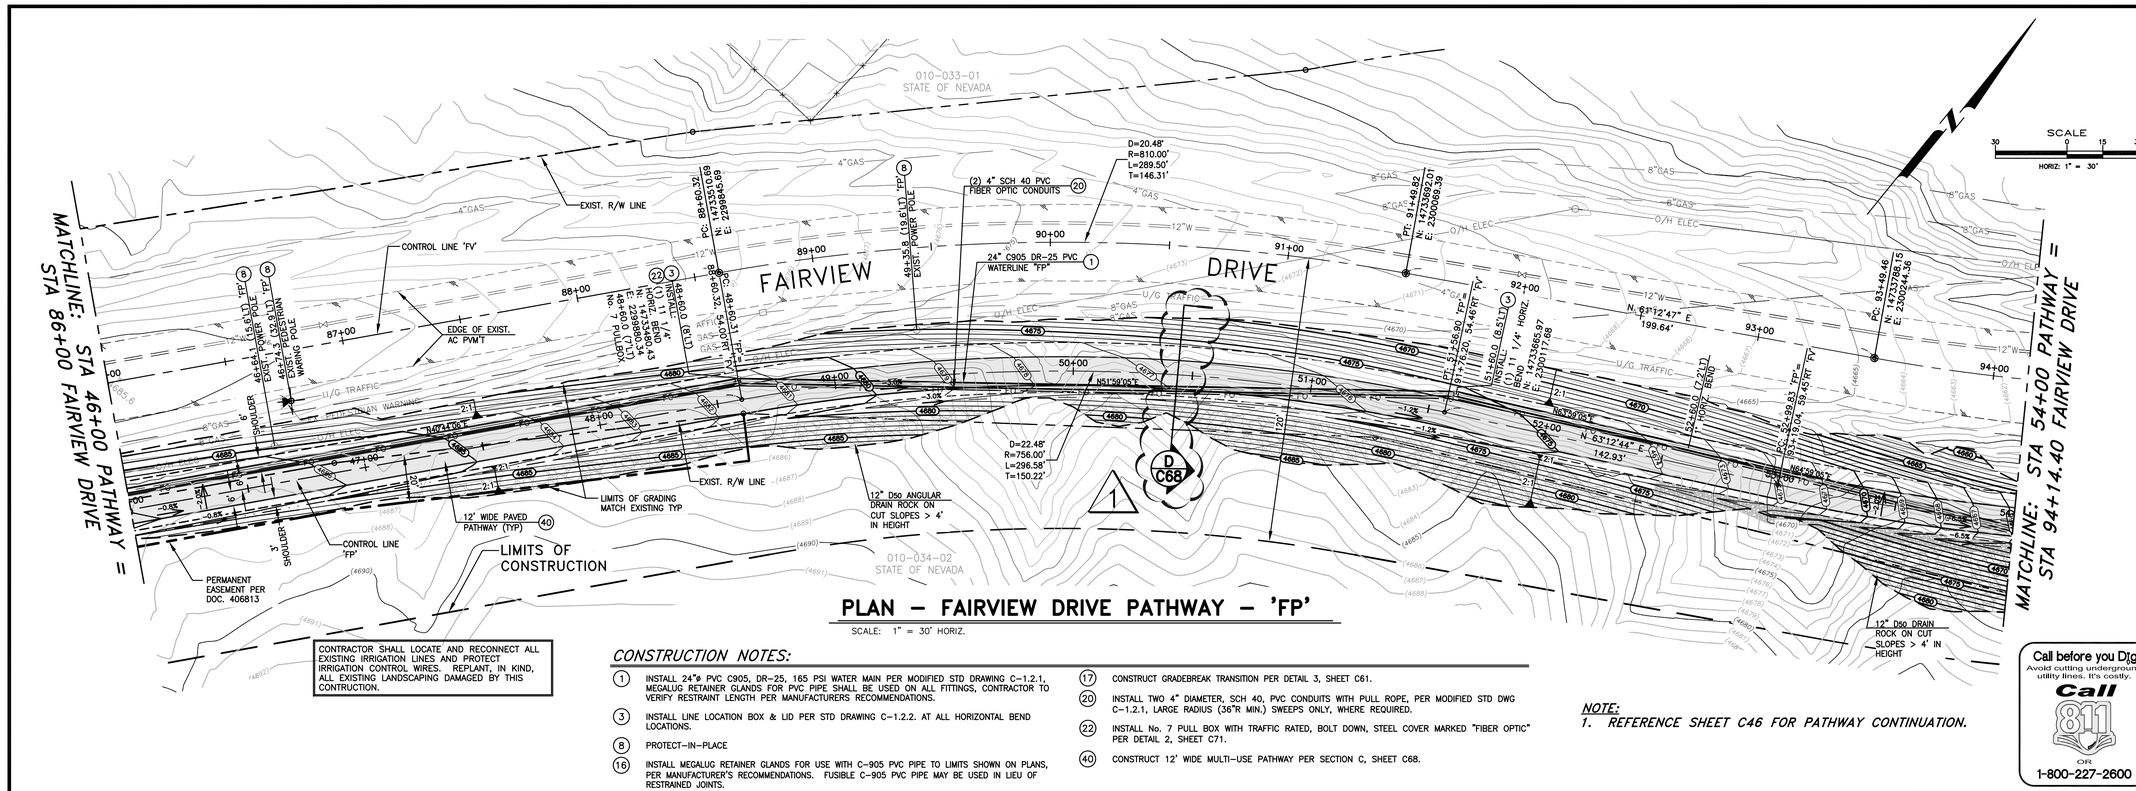

PLAN – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.

CONTRACTOR SHALL LOCATE AND RECONNECT ALL EXISTING IRRIGATION LINES AND PROTECT IRRIGATION CONTROL WIRES. REPLANT, IN KIND, ALL EXISTING LANDSCAPING DAMAGED BY THIS CONTRUCTION.

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
8. PROTECT-IN-PLACE
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
22. INSTALL No. 7 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.

NOTE:

1. REFERENCE SHEET C46 FOR PATHWAY CONTINUATION.

Call before you Dig
Avoid cutting underground utility lines. It's costly.
Call 811 OR 1-800-227-2600

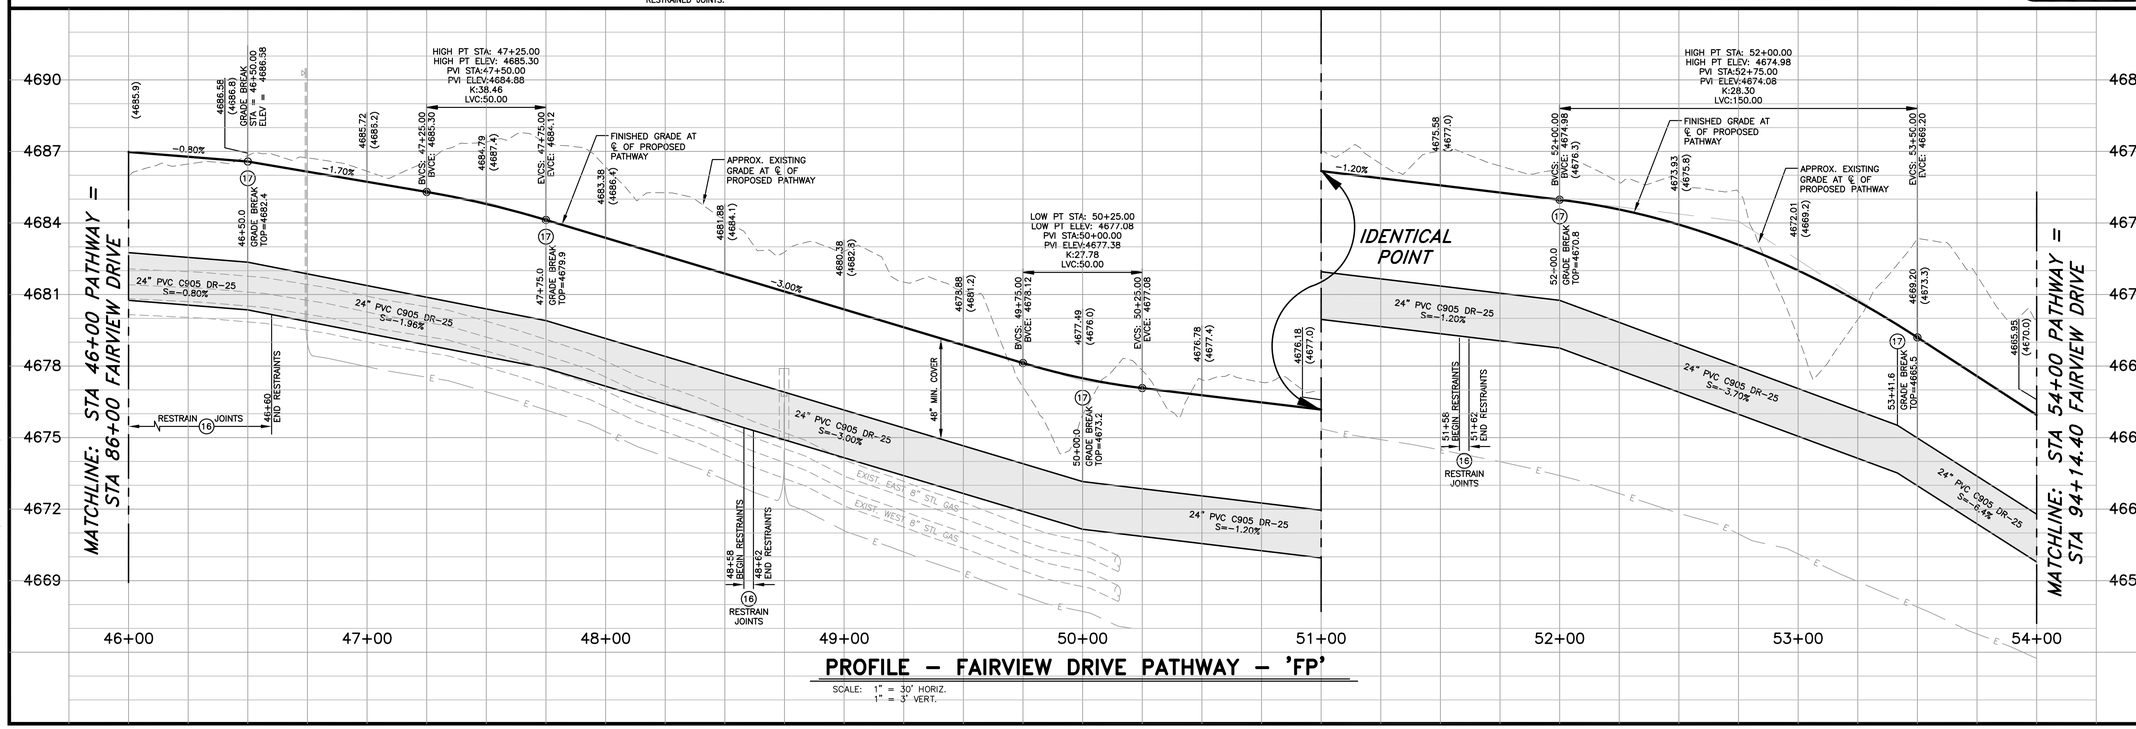

PROFILE – FAIRVIEW DRIVE PATHWAY – 'FP'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO.: gp-fairview p7-54.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

NORTH/SOUTH WATER TRANSMISSION MAIN
PROJECT – PHASE 2
PROJECT No. 4.0800
FAIRVIEW DRIVE PATHWAY
PLAN & PROFILE
STA 46+00 to STA 54+00

SHEET C44 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P7-54.dwg, 3/15/11

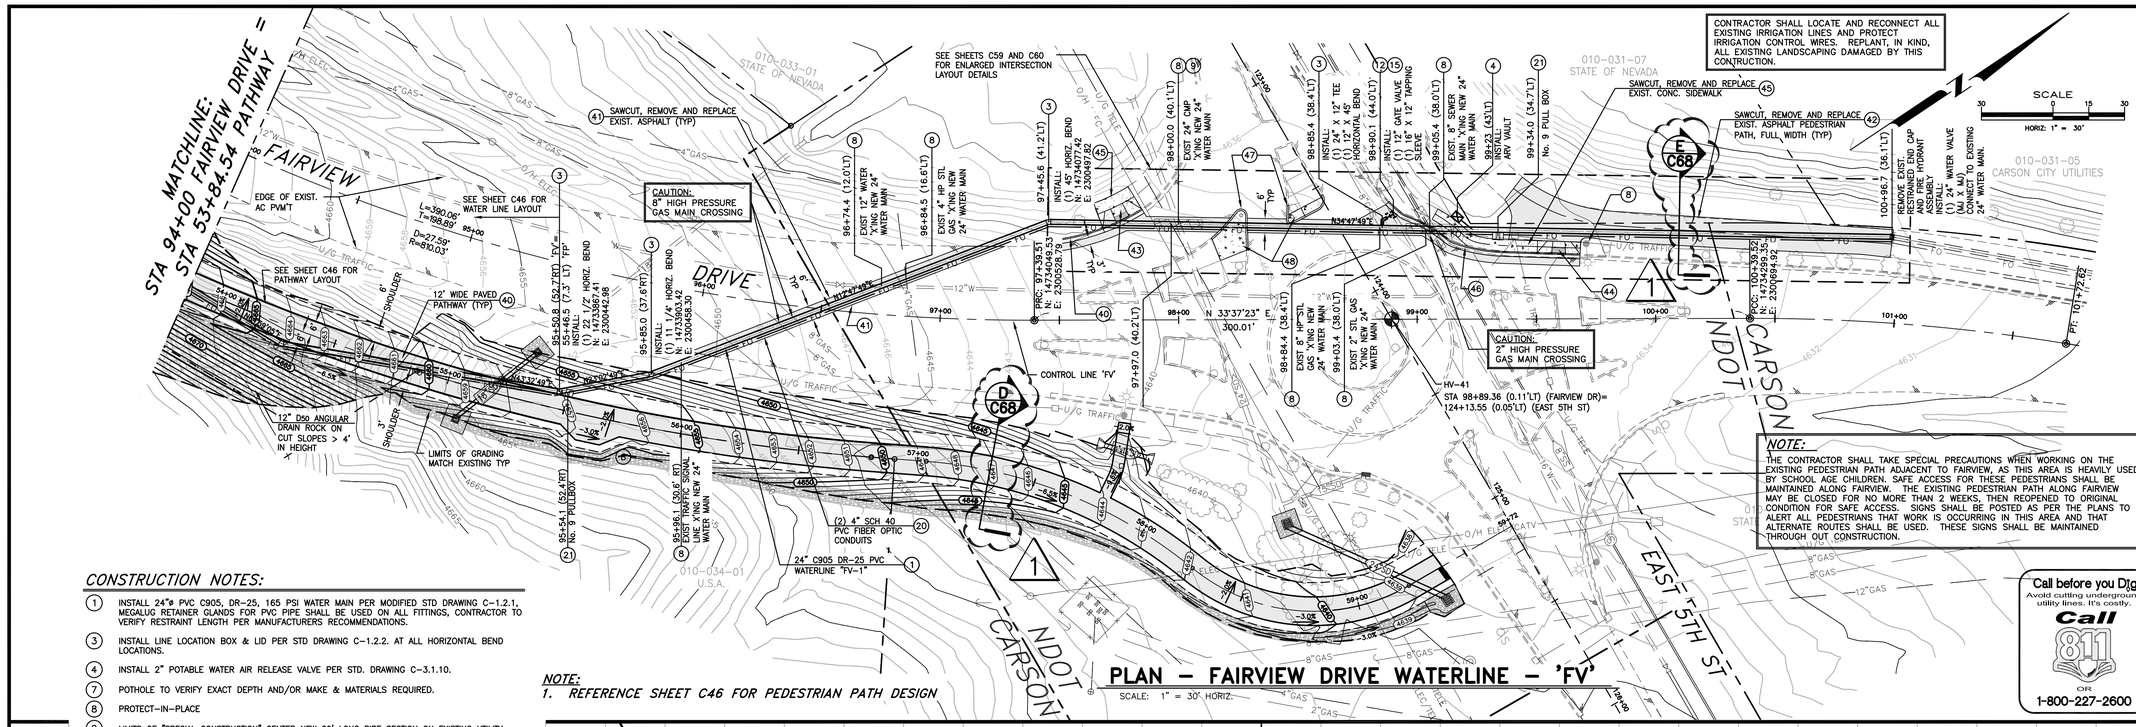

NOTE:
1. REFERENCE SHEET C46 FOR PEDESTRIAN PATH DESIGN

PLAN – FAIRVIEW DRIVE WATERLINE – 'FV'

SCALE: 1" = 30' HORIZ.

CONSTRUCTION NOTES:

1. INSTALL 24"ø PVC C905, DR-25, 165 PSI WATER MAIN PER MODIFIED STD DRAWING C-1.2.1, MEGALUG RETAINER GLANDS FOR PVC PIPE SHALL BE USED ON ALL FITTINGS, CONTRACTOR TO VERIFY RESTRAINT LENGTH PER MANUFACTURERS RECOMMENDATIONS.
3. INSTALL LINE LOCATION BOX & LID PER STD DRAWING C-1.2.2. AT ALL HORIZONTAL BEND LOCATIONS.
4. INSTALL 2" POTABLE WATER AIR RELEASE VALVE PER STD. DRAWING C-3.1.10.
7. POTHOLE TO VERIFY EXACT DEPTH AND/OR MAKE & MATERIALS REQUIRED.
8. PROTECT-IN-PLACE
9. LIMITS OF "SPECIAL CONSTRUCTION" CENTER NEW 20' LONG PIPE SECTION ON EXISTING UTILITY CROSSING. REFERENCE STD DWG C-3.1.2 AND NDEP BUREAU OF SAFE DRINKING WATER VERTICAL CROSSING CONFLICTS SUMMARY, DATED 4/10/07, ON SHEET G3. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
12. INSTALL TAPPING SLEEVE PER STD. DRAWINGS C-3.1.1 & C-3.1.3 (SIZE PER PLAN)
15. INSTALL WATER VALVE PER STD. DRAWING C-3.1.4.
16. INSTALL MEGALUG RETAINER GLANDS FOR USE WITH C-905 PVC PIPE TO LIMITS SHOWN ON PLANS, PER MANUFACTURER'S RECOMMENDATIONS. FUSIBLE C-905 PVC PIPE MAY BE USED IN LIEU OF RESTRAINED JOINTS.
17. CONSTRUCT GRADEBREAK TRANSITION PER DETAIL 3, SHEET C61.
20. INSTALL TWO 4" DIAMETER, SCH 40, PVC CONDUITS WITH PULL ROPE, PER MODIFIED STD DWG C-1.2.1, LARGE RADIUS (36"R MIN.) SWEEPS ONLY, WHERE REQUIRED.
21. INSTALL No. 9 PULL BOX WITH TRAFFIC RATED, BOLT DOWN, STEEL COVER MARKED "FIBER OPTIC" PER DETAIL 2, SHEET C71.
40. CONSTRUCT 12' WIDE MULTI-USE PATHWAY PER SECTION C, SHEET C68.
41. SAWCUT, REMOVE AND REPLACE EXISTING ASPHALT PER STD DRAWING C-5.1.6.
42. SAWCUT, REMOVE AND REPLACE EXISTING ASPHALT PEDESTRIAN PATH PER SECTION D, SHEET C68.
43. CONSTRUCT PERPENDICULAR CURB RAMP DIRECTIONAL PER STD. DRAWING C-5.3.2.
44. REMOVE AND REPLACE EXISTING PEDESTRIAN RAMP PER STD DRAWINGS C-5.3.1 AND C5.3.2.
45. REMOVE AND REPLACE EXISTING P.C.C. SIDEWALK PER STD DRAWINGS C-5.1.1, C-5.2.1 AND C-5.2.2.
46. REMOVE AND REPLACE EXISTING P.C.C. CURB AND GUTTER PER STD DRAWING C-5.1.3.
47. REMOVE AND REPLACE EXISTING TYPE 2 P.C.C. MEDIAN CURB PER STD. DRAWING C-5.1.5.1.
48. REMOVE AND REPLACE EXISTING P.C.C. MEDIAN ISLAND TO EXISTING EXPANSION JOINT PER SECTION A, SHEET C70.

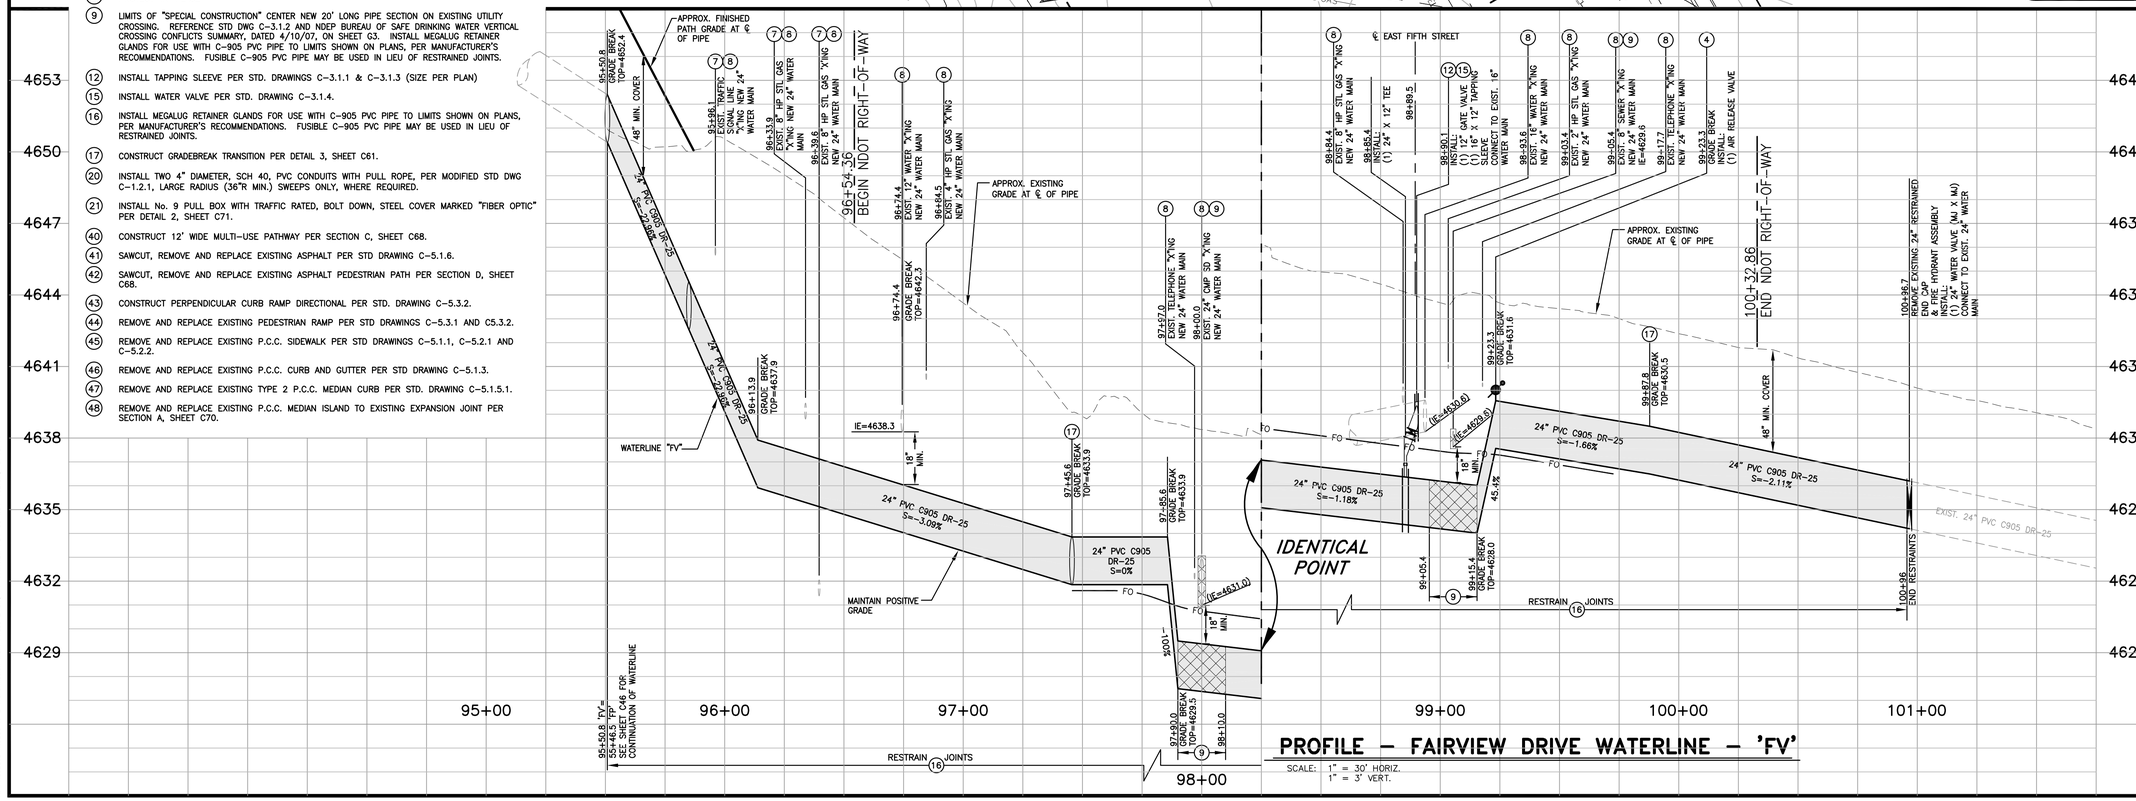

PROFILE – FAIRVIEW DRIVE WATERLINE – 'FV'

SCALE: 1" = 30' HORIZ.
1" = 3' VERT.

REV.	DATE	DESCRIPTION	BY	APP'D
1	3/10/11	REVISED SECTION DETAIL	DLO	TLG

DESIGNED BY: DGR/DLO
DRAWN BY: DGR/DLO
CHECKED BY: TLG
DWG NO. cp-fairview p54-60 w94-102.dwg
SCALE (HORIZ): 1" = 30'
SCALE (VERT): 1" = 3'
PLOT DATE: 3/15/11

CARSON CITY
PUBLIC WORKS DEPARTMENT
3505 BUTTI WAY CARSON CITY, NEVADA 89701
PH: 887-2355 FAX: 887-2112

PROFESSIONAL ENGINEER – STATE OF NEVADA
THOMAS LEON GUINN
Exp: 6-30-11
CIVIL
No. 18528

NORTH/SOUTH WATER TRANSMISSION MAIN PROJECT – PHASE 2
PROJECT No. 4.0800

FAIRVIEW DRIVE PLAN & PROFILE STA 94+00 to STA 102+00

SHEET C45 OF 96

H:\PROJECTS\4.0800 N-S Transmission Main Phase 2\dwg\PP-FAIRVIEW P54-60 W94-102.dwg, 3/15/11